



OV GMT Fuse Panel Installation Guide

Document INS-757XXXXXX

This manual covers the following part numbers-

Trimm **757XXXXXX** Family

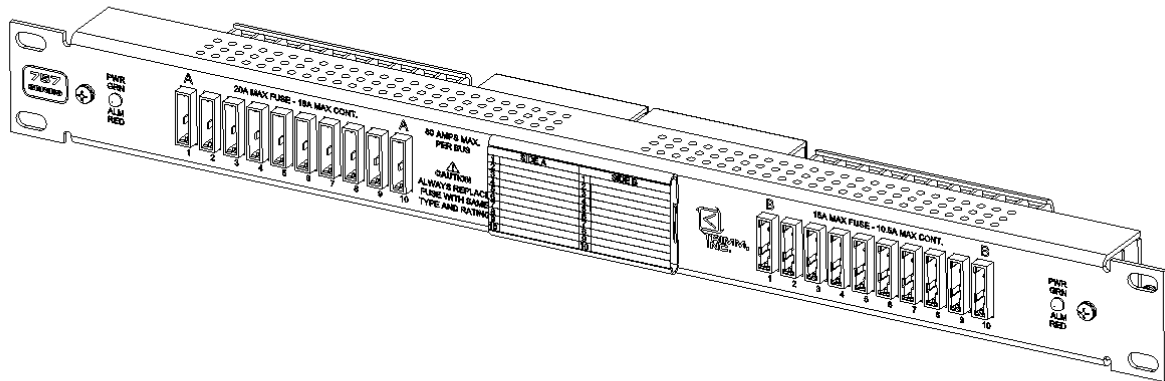


Table of Contents

Section 1- General Information.....	3
1.1 - Product Description	3
1.2 - Inspection.....	3
1.3 - What's Included	3
Section 2 – Before You Begin.....	3
2.1 - Tools Required For Installation.....	3
2.2 - Input Bus Amperage Rating.....	4
2.3 - Fuse Sizing Information	4
2.4 - Fuse Replacement Information.....	4
2.5 - Wiring Temperature Information	4
2.6 - General Notes on Terminal Connections	4
2.7 - Operating Voltage Ranges	4
2.8 - Battery Return Treatment	4
2.9 - Terminal Information.....	4
Section 3 – Rack Mounting	5
3.1 - Rack Mounting.....	5
3.2 - Additional Rack Mounting Instructions	5
Section 4 – Input and Grounding Cabling	5
4.1 - Chassis Grounding (Earthing)	5
4.2 - Input Wiring (90 Degree Compression Lug Connection).....	5
4.3 - Input Wiring (Set Screw Connection)	5
4.4 - Power Verification Test.....	5
Section 5 – Output and Alarm Cabling	6
5.1 - Output Wiring (Set Screw Connections).....	6
5.2 - Output Wiring (Barrier Strip Connections).....	6
5.3 - Alarm Wiring	6
Section 6 – Final Installation.....	6
6.1 - Fuse Installation.....	6
6.2 - Energizing the Panel.....	6
Section 7 – Fuse Ordering Information.....	7
Section 8 - Revision Record	7

Section 1- General Information

1.1 - Product Description

Trimm, Inc.'s OV GMT series of power distribution fuse panels offer fusing from .18 to 20 Amps per position with up to 40 fused positions per panel (20 per bus max.). Power and alarm status are displayed locally with relay contacts for remote fuse fail and power loss indication. This product is suitable for central office locations, network telecommunication facilities, data centers and outside plant enclosures. These OV GMT fuse panels may be installed in GR-3108 Class 3 environments¹.

¹Salt fog exposure requirements were not evaluated with these products.

1.2 - Inspection

Inspect the panel for any noticeable defects, missing parts (See "What's Included" below), or shipping damage. Please retain the original packaging in case you need to return the product to Trimm, Inc. Please notify Trimm, Inc. if any problems are found at 1-800-298-7466. Products shall not be returned to Trimm, Inc. without the proper Return Material Authorization (RMA) number.

1.3 - What's Included

This unit should be packaged with the following items. Please notify Trimm, Inc. if any of these items are not included so a replacement can be sent out right away.

- OV GMT fuse panel (verify part number from sticker on top side of the unit.)
- 4 x #12-24 x ½" self-tapping mounting screws
- A single compression lug and associated fasteners (For earthing/grounding connection only.)
- Input connector fasteners (For compression lug input connection only)
- Installation guide packet

Section 2 – Before You Begin

WARNING

This panel shall be installed in a restricted access location by qualified service personnel only.

No field servicing is required on the unit.

All connections/methods shall meet all national/local electrical codes as well as any company specific methods and procedures. Failure to do so may result in damage to the equipment, and or personal injury.

A readily accessible disconnect device must be incorporated into the supply wiring for this product. This disconnect device must be capable of interrupting the maximum available fault current determined by analysis for your system.

2.1 - Tools Required For Installation

Depending on the part number ordered the following tools may be needed to install this product.

- Multimeter
- Wire cutter/stripper
- No. 2 Phillips head torque screw driver
- 1/8" wide slotted torque screw driver
- Torque wrench with 7/16" socket
- Suitable listed crimp tooling for the field wiring terminals
- Cable ties or lacing cord
- Writing utensil or label maker for circuit designation
- Wire-Wrap tool for alarm connections (.045" square post)

Copyright © Trimm, Inc. All rights reserved.

INS-757XXXXXX Rev B. 04/12/10 OV GMT Fuse Panel Installation Guide

2.2 - Input Bus Amperage Rating

This family of products were designed to be used at their input bus amperage rating of 80 or 100 Amps, fed by a #2 AWG wire and protected by a 100 Amp (80 Amp panels) or 125 Amp (100 Amp panels) maximum over current device.

2.3 - Fuse Sizing Information

The fuse manufacturer recommends that GMT fuses rated 8 to 15 Amps be continuously operated at no more than 70% of their current rating. All other fuse types/amperages shall be continuously operated at no more than 80% of their current rating.

2.4 - Fuse Replacement Information

The correct fuses may be ordered from the table at the end of this document. See section 7

2.5 - Wiring Temperature Information

The wiring for this product shall be rated 90° C or better. Wiring protected by GMT fuses shall be at least one size larger than the minimum required wire based on the National Electric Code, NFPA 70 ampacity tables.

2.6 - General Notes on Terminal Connections

- Bare conductors and the mating surfaces of all connections should be coated with appropriate antioxidant compound before crimp connections are made.
- Use appropriate shrink tubing over un-insulated terminal barrels.
- Ensure that the mating surface of both the terminals and their connection point are clean and free of paint.
- Use only listed terminals and crimp tooling when making connections.

2.7 - Operating Voltage Ranges

The following table lists the minimum and maximum voltage that this product has been designed to operate in.

Operating Voltage Information		
Nominal Voltage	Minimum Voltage	Maximum Voltage
5 VDC	4 VDC	7.5 VDC
12 VDC	10 VDC	15.0 VDC
24 VDC	19 VDC	28.3 VDC
48 VDC	40 VDC	60 VDC

2.8 - Battery Return Treatment

This product has been designed with the input return connection isolated from the chassis ground (Earthing) connection. This product is suitable for use with either DC-I or DC-C (Isolated or Common) battery return connection applications.

2.9 - Terminal Information

The following terminals or suitable equivalents may be used for connection to this product. This recommendation is based on the panel's bus amperage rating.

757xxxxxx Family Suggested Field Wiring Terminal Specifications ¹							
Connection	Panel Bus Rating	Wire Gauge	Trimm Part Number ¹		Stud Size	Hole Spacing	Max. Width
			Standard Conductor	Flex Conductor			
Input (Compression Lug Type) 2 Hole 90 deg.	80 Amps	2 AWG	6500221223	6500221244	1/4"	5/8"	5/8"
	100 Amps	2 AWG					
Input (Set Screw Type)	Set Screw (No terminals required - see wire gauge above)						
Output (Set Screw Type)	Set Screw (No terminals required)						
Output (Barrier Strip Type)	Up to 10 AWG fork or ring terminal with a #6 stud (.325 max. tongue width)						
Chassis Ground	Terminal included with panel (compression lug)						
Remote Alarm	Set Screw or Wire Wrap (No terminal required)						
<i>1-The above list is only a suggestion. Equivalent terminals may be used provided they are listed and crimped with the appropriately listed crimp tooling. Wire gauge is based on the maximum over current device rating.</i>							

Section 3 – Rack Mounting

3.1 - Rack Mounting

Secure the panel to the rack using the self tapping screws provided. If you have purchased a 19" panel and the application is for a 23" rack, be sure that you have ordered/received Trimm, Inc's 19" to 23" adapter kit part number 7500116711 (for clear anodized finish) or part number 7500116713 (for black anodized finish). These kits include 2 brackets and 4 fasteners required to attach the brackets to the fuse panel.

3.2 - Additional Rack Mounting Instructions

If installed in a closed or multi-unit rack assembly, the operating ambient temperature of the rack environment may be greater than room ambient. Therefore, consideration should be given to installing the equipment in an environment compatible with the unit's maximum operating temperature. Mounting of the equipment in the rack should be such that a hazardous condition is not achieved due to uneven mechanical loading.

Section 4 – Input and Grounding Cabling



WARNING

Before installation, verify that the input power disconnect device is turned "OFF"

4.1 - Chassis Grounding (Earthing)

This product is suitable for use in either a Common or Isolated (CBN or IBN) Bonding Network. This panel includes a compression lug for grounding. Crimp the ground wire to the terminals provided. Attach the wires to the panel using the supplied fasteners. Torque the fasteners to 24 in-lbs. (2.7 Nm). Attach other end of ground wire to the rack or other suitable grounding location. Reliable Earthing of rack-mounted equipment should always be maintained (First On, Last Off).

4.2 - Input Wiring (90 Degree Compression Lug Connection)

Locate the input covers, flat washers and #1/4-20 locking nuts supplied with this panel. Crimp the battery and return wires to the proper terminals. Attach the wires to the panel using the supplied flat washers and locking nuts. Torque the fasteners to 24 in-lbs. (2.7 Nm). Attach the input covers over the terminal by simply pressing them onto the studs.

4.3 - Input Wiring (Set Screw Connection)

This connector accepts #1 to #20 AWG copper wires to feed into the battery and return connections. Strip the end of the wire to .710" (18mm) and insert into the connector. Torque the fasteners to 22 in-lbs. (2.5 Nm).

4.4 - Power Verification Test

This test is to verify proper function of the panel prior to the connection of loads. Turn on the over current protection/disconnect device supplying power to the A side bus. Use a multi meter to verify that voltage and polarity are correct at the input connection. Verify that the PWR/FUSE LED is illuminated "green". Verify that

Copyright © Trimm, Inc. All rights reserved.

continuity is present between C and NC fuse alarm contacts. Install a failed fuse if possible and verify that the PWR/FUSE LED changes to “red”. With the failed fuse still in place verify that continuity is present between C and NO fuse alarm contacts. If the panel is also equipped with a power alarm, verify that continuity is present between C and NC power alarm contacts when the panel is energized. Repeat these steps for the B side bus if applicable.

Section 5 – Output and Alarm Cabling

WARNING

Before continuing installation, verify that the over current protection/disconnect device is turned “OFF”

5.1 - Output Wiring (Set Screw Connections)

This panel accepts #12 to #22 AWG copper wires to feed into the battery and return connections. Strip the wires approximately .260” (6.5mm) and insert into the battery and return connections for each fused position. Torque the screw to 5 in-lbs. (.5 Nm).

5.2 - Output Wiring (Barrier Strip Connections)

This panel accepts #10 to #22 AWG copper wires to feed into the battery and return connections. Strip the wires to the appropriate length and crimp to the terminals. Remove or loosen (for fork terminals) the screws for each fused position. Attach the terminal onto the corresponding position for both battery and return connections. Torque the screw to 9 in-lbs. (1 Nm).

5.3 - Alarm Wiring

The alarm connections use standard wire wrap pins or a set screw type connection depending on the part ordered. To connect the panel to an alarm system, attach the alarm wires to the appropriate pins (C/NC or C/NO) as outlined below.

Continuity at the fuse fail alarm connector is established at positions C and NC when all the fuses are good (not failed). Continuity is established at positions C and NO when any fuse has blown (failed).

If equipped with a power fail alarm, continuity is established at positions C and NC when the panel is energized or at C and NO when the panel is not energized.

Section 6 – Final Installation

6.1 - Fuse Installation

Orient and install the correct fuse into its position. Record the protected equipment identification and location on the supplied designation card.

6.2 - Energizing the Panel

Once all steps have been completed above, and a final inspection of the installation has been completed, you may energize the fuse panel by switching the corresponding interrupt device to its “ON” position.

Section 7 – Fuse Ordering Information

GMT FUSES			
PART NUMBER	FUSE AMPERAGE	PART NUMBER	FUSE AMPERAGE
0300097000	18/100 AMP	0300097013	3-1/2 AMP
0300097001	1/4 AMP	0300097012	4 AMP
0300097016	3/8 AMP	0300097009	5 AMP
0300097002	1/2 AMP	0300097011	7-1/2 AMP
0600097065	65/100 AMP	0300097010	10 AMP
0300097003	3/4 AMP	0300097014	12 AMP
0300097004	1 AMP	0300097015	15 AMP
0300097005	1-1/3 AMP	0300097320	20 AMP ¹
0300097006	1-1/2 AMP	0300097100	DUMMY FUSE
0300097007	2 AMP	0300097209	GMT/X FUSE COVER
0300097008	3 AMP		
1- 20 Amp GMT type fuses may only be installed in panels designed/rated for its use. See product specifications.			

Section 8 - Revision Record

Legend:

Type	R=Revision	A=Addition	D=Deletion
	T=Typo	N=New	V=Review

Revision	Date	Type	Section/Comments
A	08/28/09	N	New Document
B	04/12/10	R	Revised wording of multiple paragraphs to clarify intent