


NOTES:

- ① - INPUT: TWO HOLE STUD TYPE FOR BATTERY INPUT AND GROUND CONNECTION. 6 AWG. COMPRESSION LUG PROVIDED.
- ② - EQUIPMENT CONNECTIONS: SET SCREW TYPE ACCEPTS 26-14 AWG.
- ③ - ALARM CONTACTS: SET SCREW TYPE ACCEPTS 26-14 AWG. 125VDC OR 125VAC. MAXIMUM SWITCHING POWER 30 WATTS DC OR 60 VA AC (RESISTIVE LOAD). RELAY CHANGES STATE WHEN FUSE FAILS ONLY.
- ④ - OTHER EQUIPMENT CONNECTION TYPES AVAILABLE: TAB OR BARRIER STRIP
- ⑤ - ALARM/POWER INDICATOR: RED/GREEN LED TYPE.
- ⑥ - FUSE HOLDER: ACCEPTS GMT TYPE FUSES UP TO 15 AMPS PER POSITION (60 AMPS MAX. PER SIDE). 10, 20, AND 20/20 POSITION BOXES ALSO AVAILABLE.
- ⑦ - DESIGNATION: CARD FOR EQUIPMENT/FUSE IDENTIFICATION.
- ⑧ - MOUNTING: FLUSH, 4 OR 5 INCH MOUNTING. UNIVERSAL 19 AND 23 INCH BRACKETS
- ⑨ - FRAME FINISH IS CLEAR ANODIZED STANDARD. OTHER FINISHES AND CUSTOM SILKSCREENS CAN BE SUPPLIED.
- 10 - PANEL CAN BE SUPPLIED WITH FUSES INSTALLED.
- ⑪ - PLASTIC COVER W/ONE CAPTIVE PANEL SCREW SUPPLIED AS A KIT
- ⑫ - #6-32 CHASSIS GROUND CONNECTION (2 PLACES)

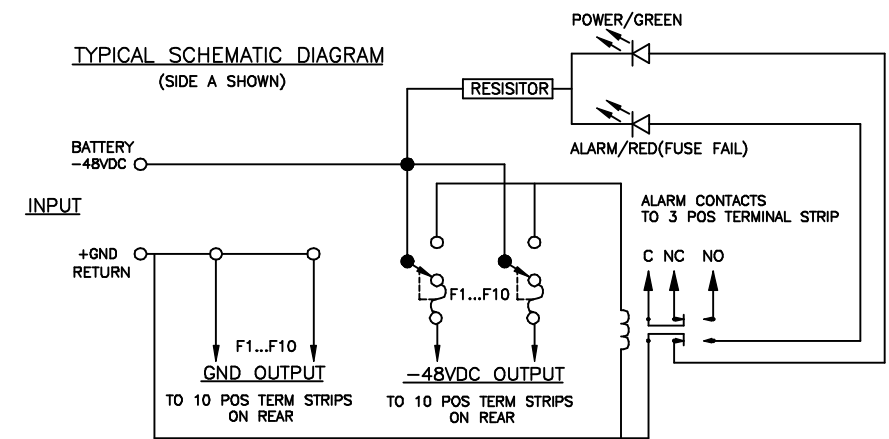

PART NO.	VOLTAGE
7570219001	-48VDC
7570219002	-24VDC
7570219003	+24VDC
7570219004	+12VDC

ISSUE: C 06/12/00 BEB
 ECN#: 99050701
 UPDATED CHASSIS/REARPLATE
 UPDATED NOTES
 ISSUE: B 5-29-96 AS
 ECN#: 96052901
 ADDED COVERS OVER STUDS INPUT
 ADD NOTE 11

OV FUSE PANEL, 10/10 POSITION GMT
 (-48VDC SHOWN) 60 AMPS MAX./SIDE

SIZE	FILE CODE	DRAWING NO.	ISSUE
B	MKT757	7570219000	C

PHONE: 847-362-3700 LIBERTYVILLE
 FAX: 847-680-3888
TRIMM, INC. ILLINOIS

REVISIONS
 APPROVED BY DATE
 CK. BY: LMM
 DRAWN BY DATE
 LMM 12/06/95